


Belimo Pressure Independent Control Valve Range

- Energy Valve





Technical Databook



Version 3.2

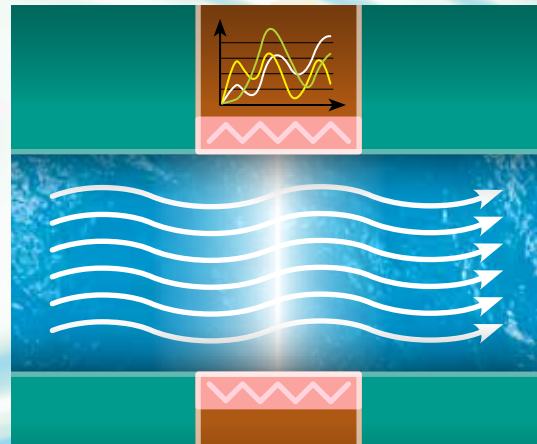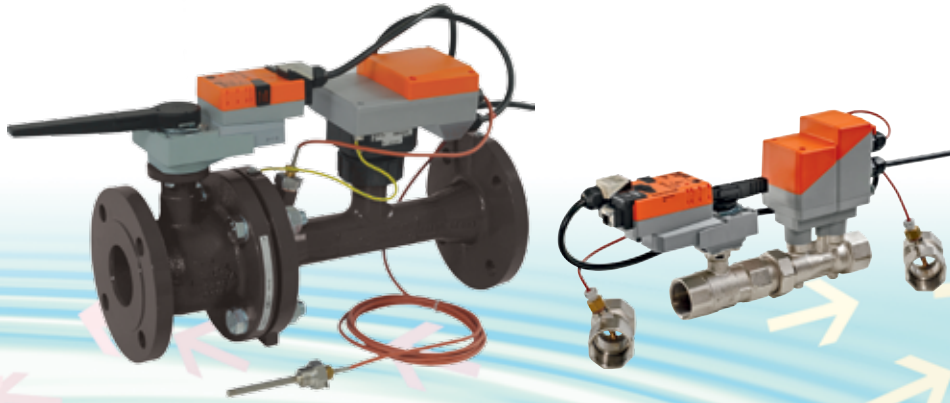

Energy Valve



Energy Valve – measures the load/coil supply and return temperature and calculates the power or energy consumed, and communicates to Higher Building Management levels

Belimo Energy Valve™	Model No.	Frequency [Hz]	DN [mm]	Torque [Nm]	Nominal Flow		Adjustable max. flow rate [m³/h]
					[l/s]	[l/min]	
	EV015R+BAC	50/60	15	5Nm	0.35	21	0.38...1.26
	EV020R+BAC	50/60	20	5Nm	0.65	39	0.7...2.34
	EV025R+BAC	50/60	25	5Nm	1.15	69	1.24...4.14
	EV032R+BAC	50/60	32	10Nm	1.8	108	1.94...6.48
	EV040R+BAC	50/60	40	10Nm	2.5	150	2.7...9
	EV050R+BAC	50/60	50	20Nm	4.8	288	5.18...17.28
	EV050R+BAC-N	50/60	50	20Nm	6.3	378	6.8...22.68
	P6065W800EV-BAC	50	65	20Nm	8	480	8.64...28.8
	P6080W1100EV-BAC	50	80	20Nm	11	660	11.88...39.6
	P6100W2000EV-BAC	50	100	40Nm	20	1200	21.6...72
	P6125W3100EV-BAC	50	125	40Nm	31	1860	33.48...111.6
	P6150W4500EV-BAC	50	150	40Nm	45	2700	48.6...162
	P6065W806EV-BAC	60	65	20Nm	8	480	8.64...28.8
	P6080W1106EV-BAC	60	80	20Nm	11	660	11.88...39.6
	P6100W2006EV-BAC	60	100	40Nm	20	1200	21.6...72
	P6125W3106EV-BAC	60	125	40Nm	31	1860	33.48...111.6
	P6150W4506EV-BAC	60	150	40Nm	45	2700	48.6...162

Note:


- The Energy Valve (EV) must be ordered together with the Rotary Actuator.
- Ordering sample:
No part on Energy Valve can be ordered as a standard product.

Content

Product Overview	4
EV	
EV..R+BAC	5
P6..W..EV-BAC	7
Technical Data	9
Mounting Instructions	18

Characterised control valve (CCV) with sensor-operated flow rate or power control, power and energy-monitoring function, 2-way, internal thread

- Nominal voltage AC/DC 24V
- Control modulating
- For modulating water-side control of air handling systems and heating systems
- Ethernet 10/100 Mbit/s, TCP/IP, integrated web server
- Communication via BACnet IP, BACnet MS/TP, Belimo MP-Bus or conventional control

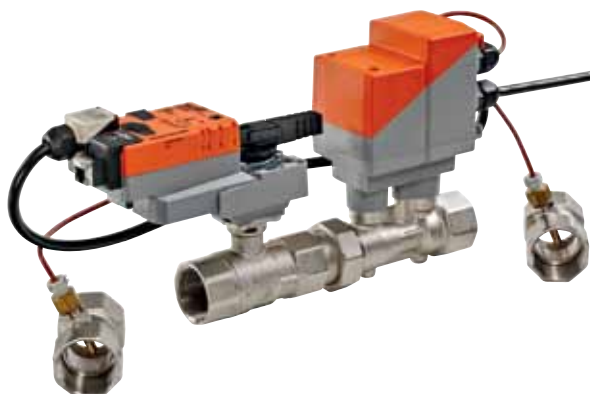

Type overview

Model No.	Frequency [Hz]	\dot{V}_{nom} [l/s]	\dot{V}_{nom} [l/min]	kvs theor.* [m³/h]	DN [mm]	Rp ["]	ps** [kPa]	n(gl) []
EV015R+BAC	50/60	0.35	21	2.9	15	1/2	1600	3.2
EV020R+BAC	50/60	0.65	39	4.9	20	3/4	1600	3.2
EV025R+BAC	50/60	1.15	69	8.6	25	1	1600	3.2
EV032R+BAC	50/60	1.8	108	14.2	32	1 1/4	1600	3.2
EV040R+BAC	50/60	2.5	150	21.3	40	1 1/2	1600	3.2
EV050R+BAC	50/60	4.8	288	32.0	50	2	1600	3.2
EV050R+BAC-N	50/60	6.3	378	32.0	50	2	1600	3.2

* : Theoretical kvs value for pressure drop calculation

** : Maximum allowable pressure

Technical data

Electrical data	Nominal voltage	AC/DC 24V
	Nominal voltage frequency	50/60Hz
	Nominal voltage range	AC 19.2...28.8V / DC 21.6...28.8V
	Power consumption in operation	5W
	Power consumption in rest position	3.9W
	Power consumption for wire sizing	7.5VA
	Connection supply / control	Cable 1m, 6 x 0.75mm²
Flow measurement	Connection control Ethernet	RJ45 socket
	Parallel operation	Yes (note the performance data)
	Measuring principle	Ultrasonic volumetric flow measurement
	Measuring accuracy	±2% (of 25...100% \dot{V}_{nom} at 20°C, Glycol 0% vol.)
Functional data	Min. flow measurement	0.5% of \dot{V}_{nom}
	Torque motor	5Nm (DN 15...25) / 10Nm (DN 32 - 40) / 20Nm (DN 50)
	Communication protocol	BACnet IP, BACnet MS/TP TCP/IP Belimo MP-Bus
	Positioning signal Y	DC 0...10V
	Operating range Y	DC 2...10V
	Operating range Y variable	DC 0.5...10V
	Position feedback U	DC 2...10V
	Position feedback U variable	DC 0...10V DC 0.5...10V
	Sound power level motor max.	45dB(A)
	Adjustable flow rate \dot{V}_{max}	30...100% of \dot{V}_{nom}
	Control accuracy	±5% (of 25...100% \dot{V}_{nom} at 20°C, Glycol 0% vol.)
	Configuration	Web browser via TCP/IP Portable handheld ZTH AP via MP-Bus
	Media	Cold and hot water, water with glycol up to max. 60% vol.
	Media temperature	-10°C...120°C

Technical data

Functional data	Pressure rating	PN16
	Closing pressure Δp_s	1380kPa
	Differential pressure Δp_{max}	350kPa
	Flow characteristic	Equal percentage (VDI/VDE 2178), linear
	Leakage rate	Air bubble-tight (Leakage rate A, EN12266-1)
	Pipe connections	Internal thread (ISO 7-1 / EN10226-1)
	Installation position	Upright to horizontal (in relation to the stem)
	Maintenance	Maintenance-free
	Manual override	Gear disengagement with push-button, can be locked
Temperature measurement	Running time	90s
	Measuring accuracy of the absolute temperature	PT1000 EN60751 Class B (For 1/3 DIN PT1000 EN60751 Class AA, refer to accessories ZM-T30-AA)
	Measuring accuracy of Delta T	$\pm 0.18^\circ\text{C}$ @ $\Delta T = 10^\circ\text{C}$
	Resolution	0.1°C
Safety	Protection class IEC/EN	III Safety extra-low voltage
	Degree of protection IEC/EN	IP54 (with protective cap for RJ45 socket)
	EMC	CE according to 2004/108/EC
	Mode of operation	Type 1
Materials	Rated impulse voltage supply / control	0.8kV
	Control pollution degree	3
	Ambient temperature	-30...50°C
	Non-operating temperature	-40...80°C
	Ambient humidity	95% r.h., non-condensing
	Housing	Brass body, nickel-plated
	Measuring pipe	Brass body, nickel-plated
	Ball	Stainless steel AISI 316
	Stem	Stainless steel AISI 304
	Stem seal	O-ring EPDM
	Immersion well	Brass
	T-Piece	Brass body, nickel-plated


Safety notes



- This device has been designed for use in stationary heating, ventilation and air conditioning systems and is not allowed to be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied with during installation.
- The connection between the control valve and the measuring tube should not be separated.
- The device contains electrical and electronic components and is not allowed to be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Characterised control valve (CCV) with sensor-operated flow rate or power control, power and energy-monitoring function, 2-way, PN16 flange

- Nominal voltage AC/DC 24V
- Control modulating
- For modulating water-side control of air handling systems and heating systems
- Ethernet 10/100 Mbit/s, TCP/IP, integrated web server
- Communication via BACnet IP, BACnet MS/TP, Belimo MP-Bus or conventional control

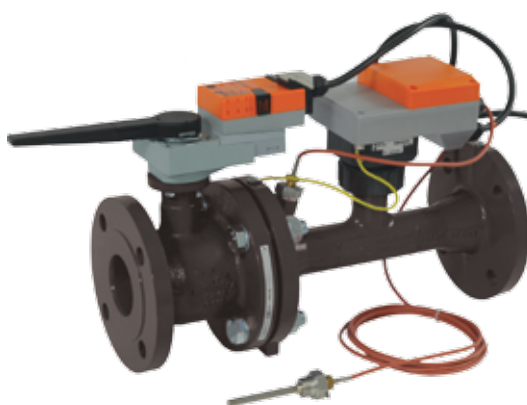

Type overview

Model No.	Frequency [Hz]	\dot{V}_{nom} [l/s]	\dot{V}_{nom} [l/min]	kvs theor.* [m³/h]	DN [mm]	DN ["]	ps** [kPa]	n(gl) [°]
P6065W800EV-BAC	50	8	480	40	65	2 1/2	1600	3.2
P6080W1100EV-BAC	50	11	660	60	80	3	1600	3.2
P6100W2000EV-BAC	50	20	1200	100	100	4	1600	3.2
P6125W3100EV-BAC	50	31	1860	160	125	5	1600	3.2
P6150W4500EV-BAC	50	45	2700	240	150	6	1600	3.2
P6065W806EV-BAC	60	8	480	40	65	2 1/2	1600	3.2
P6080W1106EV-BAC	60	11	660	60	80	3	1600	3.2
P6100W2006EV-BAC	60	20	1200	100	100	4	1600	3.2
P6125W3106EV-BAC	60	31	1860	160	125	5	1600	3.2
P6150W4506EV-BAC	60	45	2700	240	150	6	1600	3.2

* : Theoretical kvs value for pressure drop calculation

** : Maximum allowable pressure

Technical data

Electrical data	Nominal voltage	AC/DC 24V
	Nominal voltage frequency	50/60Hz
	Nominal voltage range	AC 19.2...28.8V / DC 21.6...28.8V
	Power consumption in operation	10W
	Power consumption in rest position	8.5W
	Power consumption for wire sizing	14VA
	Connection supply / control	Cable 1m, 6 x 0.75mm²
	Connection control Ethernet	RJ45 socket
	Parallel operation	Yes (note the performance data)
Flow measurement	Measuring principle	Magnetic inductive volumetric flow measurement
	Measuring accuracy	±2% (of 25...100% \dot{V}_{nom} at 20°C, Glycol 0% vol.)
	Min. flow measurement	1.25% of \dot{V}_{nom}
Functional data	Torque motor	20Nm (DN 65...80) / 40 Nm (DN 100...150)
	Communication protocol	BACnet IP, BACnet MS/TP TCP/IP Belimo MP-Bus
	Positioning signal Y	DC 0...10V
	Operating range Y	DC 2...10V
	Operating range Y variable	DC 0.5...10V
	Position feedback U	DC 2...10V
	Position feedback U variable	DC 0...10V DC 0.5...10V
	Sound power level motor max.	45dB(A)
	Adjustable flow rate Vmax	30...100% of \dot{V}_{nom}
	Control accuracy	±5% (of 25...100% \dot{V}_{nom} at 20°C, Glycol 0% vol.)
	Configuration	Web browser via TCP/IP Portable handheld ZTH AP via MP-Bus
	Media	Cold and hot water, water with glycol up to max. 60% vol.
	Media temperature	-5°C...120°C

Technical data

Functional data	Pressure rating	PN16
	Closing pressure Δp_s	690kPa
	Differential pressure Δp_{max}	340kPa
	Flow characteristic	Equal percentage (VDI/VDE 2178), linear
	Leakage rate	Air bubble-tight (Leakage rate A, EN12266-1)
	Pipe connections	Flange (ISO 7005-2 / EN 1092-1)
	Installation position	Upright to horizontal (in relation to the stem)
	Maintenance	Maintenance-free
Temperature measurement	Manual override	Gear disengagement with push-button, can be locked
	Running time	90s
	Measuring accuracy of the absolute temperature	PT1000 EN60751 Class B (For 1/3 DIN PT1000 EN60751 Class AA, refer to accessories EV-RT-100-AA)
	Measuring accuracy of Delta T	$\pm 0.18^\circ\text{C}$ @ $\Delta T = 10^\circ\text{C}$
Safety	Resolution	0.1°C
	Protection class IEC/EN	III Safety extra-low voltage
	Degree of protection IEC/EN	IP54 (with protective cap for RJ45 socket)
	EMC	CE according to 2004/108/EC
Materials	Mode of operation	Type 1
	Rated impulse voltage supply / control	0.8kV
	Control pollution degree	3
	Ambient temperature	-10...50°C
	Non-operating temperature	-20...80°C
	Ambient humidity	95% r.h., non-condensing
	Housing	EN-JL1040 (GG25), with protective paint
	Measuring pipe	EN-GJS-500-7U (GGG50 with protective paint)
	Ball	Stainless steel AISI 316
	Stem	Stainless steel AISI 304
	Stem seal	EPDM Perox
	Immersion well	Brass body, nickel-plated

Safety notes




- This device has been designed for use in stationary heating, ventilation and air conditioning systems and is not allowed to be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied with during installation.
- The connection between the control valve and the measuring tube should not be separated.
- The device contains electrical and electronic components and is not allowed to be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Product features
Mode of operation


The actuator is comprised of four components: characterised control valve (CCV), measuring pipe with volumetric flow sensor, temperature sensors and the actuator itself. The adjusted maximum flow (\dot{V}_{\max}) is assigned to the maximum positioning signal (typically 10V/100%). Alternatively, the positioning signal can be assigned to the valve opening angle or to the power required on the heat exchanger (see power control). The actuator control can be either communicative or analogue. The medium is detected by the sensor in the measuring pipe and is applied as the flow value. The measured value is balanced with the setpoint. The actuator corrects the deviation by changing the valve position. The angle of rotation α varies according to the differential pressure through the final controlling element (see volumetric flow curves).

Flow rate curves

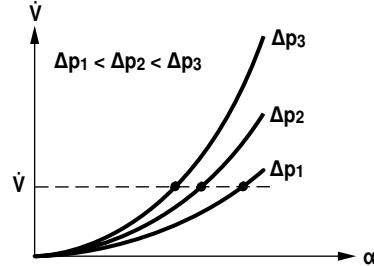
Flow characteristic of the characterised control valve

Heat exchanger transfer response

Depending on the construction, temperature spread, medium and hydraulic circuit, the power Q is not proportional to the volumetric flow of the water \dot{V} (curve 1). With the classical type of temperature control, an attempt is made to maintain the control signal Y proportional to the power Q (curve 2). This is achieved by means of an equal-percentage valve characteristic curve (curve 3).

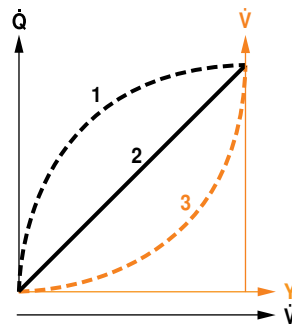
Power control

Alternatively, the positioning signal Y can be assigned to the output power required on the heat exchanger.

Depending on the water temperature and air conditions, the Energy Valve ensures the amount of water required \dot{V} to achieve the desired power.

Maximum controllable power on heat exchanger in power control mode:

DN 15	30 kW
DN 20	60 kW
DN 25	100 kW
DN 32	160 kW
DN 40	210 kW
DN 50	410 kW

DN 65	700 kW
DN 80	1000 kW
DN 100	1700 kW
DN 125	2700 kW
DN 150	3800 kW


Control characteristics

The specially configured control parameters in connection with the precise flow rate sensor ensure a stable quality of control. They are however not suitable for rapid control processes, i.e. for domestic water control.

Definition of flow rate


\dot{V}_{nom} is the maximum possible flow.

Product features

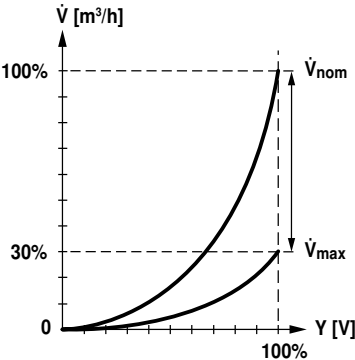

\dot{V}_{\max} is the maximum flow rate which has been set with the greatest positioning signal, e.g. 10V. \dot{V}_{\max} can be set to between 30% and 100% of \dot{V}_{nom} .
 \dot{V}_{\min} 0% (non-variable).

Performance definition Q_{\max} is the set maximum power output on the heat exchanger (in power control operating mode)


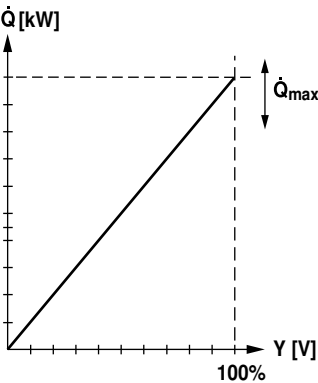


Creep flow suppression Given the very low flow speed in the opening point, this can no longer be measured by the sensor within the required tolerance. This range is overridden electronically.

Opening valve
The valve remains closed until the volumetric flow required by the positioning signal Y corresponds to 0.5% of \dot{V}_{nom} (DN15-DN50) / 1.25% of \dot{V}_{nom} (DN65-DN150). The control along the valve characteristic curve is active after this value has been exceeded.

Closing valve (DN15-DN50)
The control along the valve characteristic curve is active up to the required flow rate of 1% of \dot{V}_{nom} . Once the level falls below this value, the flow rate is maintained at 1% of \dot{V}_{nom} . If the level falls below the flow rate of 0.5% of \dot{V}_{nom} required by the reference variable Y , then the valve will close.

Closing valve (DN65-DN150)
The control along the valve characteristic curve is active up to the required flow rate of 2.5% of \dot{V}_{nom} . Once the level falls below this value, the flow rate is maintained at 2.5% of \dot{V}_{nom} . If the level falls below the flow rate of 0.5% of \dot{V}_{nom} required by the reference variable Y , then the valve will close.

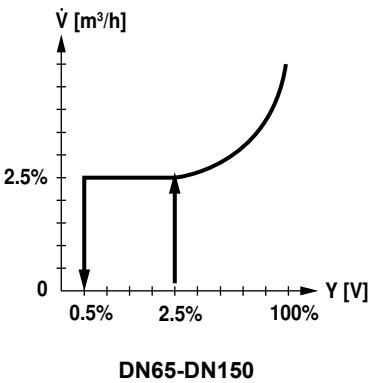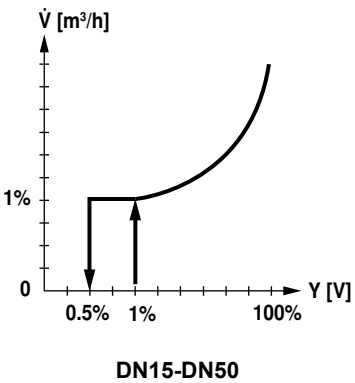

Product features
Communication

The parameterisation can be carried out through the integrated web server (RJ45 connection to the web browser) or by communicative means. Additional information regarding the integrated web server can be found in the separate documentation.

“Peer to Peer” connection

<http://belimo.local:8080>


The Notebook must be set to “DHCP”.
Make sure that only one network connection is active.

Standard IP address:

<http://192.168.0.10:8080>
Static IP address

Password (read-only):

User name: guest
Password: guest

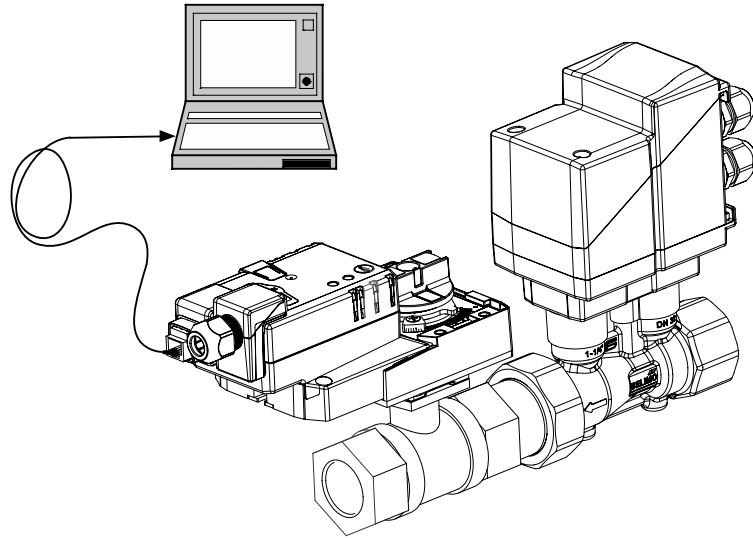
Positioning signal inversion

This can be inverted in cases of control with an analogue positioning signal. The inversion causes the reversal of the standard behaviour, i.e. at a positioning signal of 0%, regulation is to \dot{V}_{max} or Q_{max} , and the valve is closed at a positioning signal of 100%.

Hydraulic balancing


Via the integrated web server, the maximum flow rate (equivalent to 100% requirement) can be adjusted directly on the device itself, simply and reliably, in a few steps. If the device is integrated in the management system, then the balancing can be handled directly by the management system.

Delta-T manager

If a heating or cooling register is operated with a differential temperature that is too low and thus with a flow rate that is too high, this will not result in an increased power output. Nevertheless, heating or cooling machines must provide the energy at a lower degree of effectiveness. Pumps circulate too much water and increase energy consumption unnecessarily.

With the aid of the Energy Valve, it is simple to discover that operation is being carried out at a differential temperature that is too low, resulting in the inefficient use of energy. Necessary setting adjustments can now be carried out quickly and easily at any time. The integrated differential temperature control offers the user in addition the possibility of defining a low limit value. The Energy Valve limits the flow rate automatically to prevent the level from falling below this value.

- Power output of the heating or cooling registers 1
- Differential temperature between supply and return 2
- Loss zone (heating or cooling register saturation) 3
- Adjustable minimum differential temperature 4

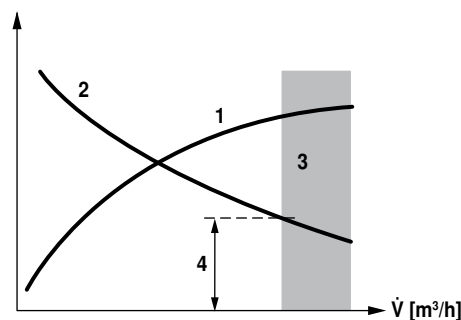
Combination analogue - communicative

The integrated web server, BACnet IP, BACnet MS/TP or MP bus can be used for the communicative position feedback with conventional control by means of an analogue positioning signal.

When the combination of positioning signal Y and communicative position feedback is used, it is imperative to ensure that the communicative path is used solely for data transfer from the Energy Valve to the higher-level management system. If values are transferred communicatively via bus to the Energy Valve, then the analogue control will be automatically deactivated.

This deactivation can be reversed by disconnecting the Energy Valve from the power supply.

Product features

Power and energy monitoring function

The actuator is equipped with two temperature sensors. A sensor (T2) must be installed at the valve and the second sensor (T1) must be installed on-site on the other side of the water circulation. The two sensors are enclosed with the system already wired. The sensors are used to record the medium temperature of the supply and return lines of the consumer (heat/cold register). As the water quantity is also known, thanks to the volumetric flow measurement integrated in the system, the power released from the consumer can be calculated. Furthermore, the heating/cooling energy is also determined automatically by means of the evaluation of the power over time.

The current data, e.g. temperatures, volumetric flow volumes, exchanger energy consumption, etc. can be recorded and accessed at any time by means of web browsers or communication (BACnet or MP-Bus).

Data recording

The recorded data (integrated data recording for 13 months) can be used for the optimisation of the overall system and for the determination of the performance of the consumer.

Download csv files through web browser.

Manual override

Manual override with push-button possible (the gear is disengaged for as long as the button is pressed or remains locked).

High functional reliability

The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.

Home position

The actuator moves to the home position when the supply voltage is switched on for the first time, i.e. at the time of commissioning or after pressing the "gear disengagement" key. The actuator then moves into the required position in order to ensure the flow rate defined by the positioning signal.

Accessories

	Description	Type
Service Tools	Service tool, for MF/MP/Modbus/LonWorks actuators and VAV controller	ZTH AP
	Remote temperature sensor pair 1/3m, to DN15-50, 1/3 DIN PT1000 EN60751 Class AA	ZM-T30-AA
	Remote temperature sensor pair 1/10m, to DN65-150, 1/3 DIN PT1000 EN60751 Class AA	EV-RT-100-AA

Electrical installation




Notes

- Connection via safety isolating transformer.
- Parallel connection of other actuators possible. Observe the performance data.

Wiring diagrams


BACnet IP

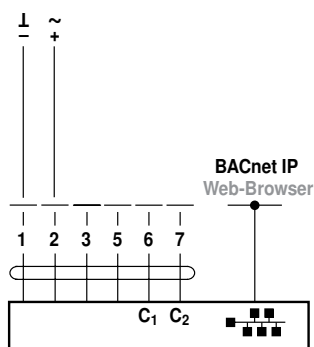

Cable colours:

- 1 = black
- 2 = red
- 3 = white
- 5 = orange
- 6 = pink
- 7 = grey


BACnet MS/TP

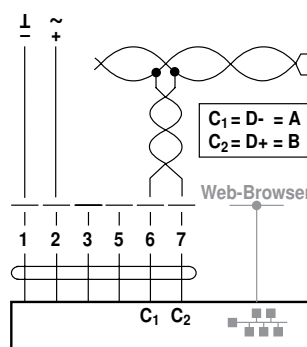

Cable colours:

- 1 = black
- 2 = red
- 3 = white
- 5 = orange
- 6 = pink
- 7 = grey


MP-Bus

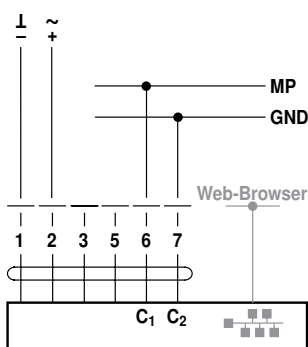

Cable colours:

- 1 = black
- 2 = red
- 3 = white
- 5 = orange
- 6 = pink
- 7 = grey


Conventional operation

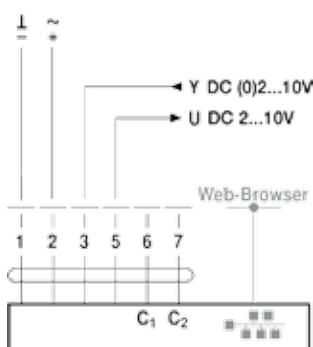

Cable colours:

- 1 = black
- 2 = red
- 3 = white
- 5 = orange
- 6 = pink
- 7 = grey

Electrical installation




Connection of a notebook for parameterisation and manual control via RJ45.

Optional connection via RJ45 (direct connection Notebook / connection via Intranet or Internet) for access to the integrated webserver

Functions


Functions for actuators with specific parameters (Parametrisation with web server necessary)

Override control and limiting with DC 24V with relay contacts (only with conventional control)

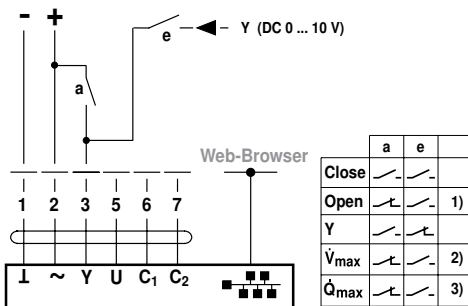

- 1) Position control
- 2) Flow control
- 3) Power control

Display and operating elements

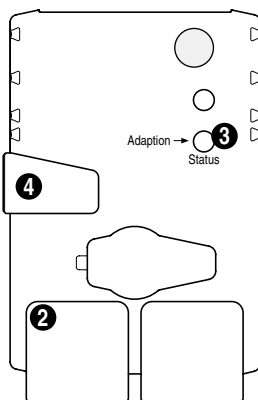

(2) LED display green

Off: No supply or wiring error

Illuminated: Operation

Flickering: Internal communication valve (valve / sensor)

(3) Push-button and LED display yellow

Illuminated: Adaptation procedure active

Press button: Triggers angle of rotation adaptation, followed by standard mode

(4) Gear disengagement button


Press button: Gear disengages, motor stops, manual override possible

Release button: Gear engages, followed by standard mode

Installation notes

Recommended installation positions

The ball valve can be installed upright to horizontal. The ball valve may not be installed in a hanging position, i.e. with the stem pointing downwards.



Installation position in return Water quality requirements

Installation in the return is recommended.

The water quality requirements specified in VDI 2035 must be adhered to.

Belimo valves are regulating devices. In order for these control tasks to be able to be carried out in the long run as well, they are to be kept free of solid particles (e.g. welding beads during installation work).

The installation of correspondingly sufficient dirt catchers is recommended.

Maintenance

Ball valves, rotary actuators and sensors are maintenance-free.

Before any kind of service work is carried out on the actuator, it is essential to isolate the rotary actuator from the power supply (by disconnecting the electrical cable). Any pumps in the part of the piping system concerned must also be switched off and the appropriate slide valves closed (allow everything to cool down first if necessary and reduce the system pressure to ambient pressure level).


Installation notes

- Maintenance

The system must not be returned to service until the ball valve and the rotary actuator have been properly reassembled in accordance with the instructions and the pipelines have been refilled in the proper manner.
- Flow direction

The direction of flow, specified by an arrow on the housing, is to be complied with, since otherwise the flow rate will be measured incorrectly.
- Earthing


Above DN65, it is imperative that the measuring pipe be correctly earthed in order to ensure that the volumetric flow sensor does not make any unnecessary incorrect measurements.

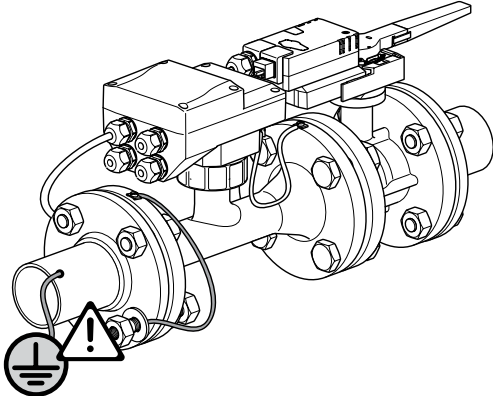


- Inlet section

In order to achieve the specified measuring accuracy, a flow-calming section or inflow section in the direction of the flow is to be provided upstream from the measuring pipe flange. Its dimensions should be at least 5x DN.

DN	L min.
15	5 x 15 mm = 75 mm
20	5 x 20 mm = 100 mm
25	5 x 25 mm = 125 mm
32	5 x 32 mm = 160 mm
40	5 x 40 mm = 200 mm
50	5 x 50 mm = 250 mm

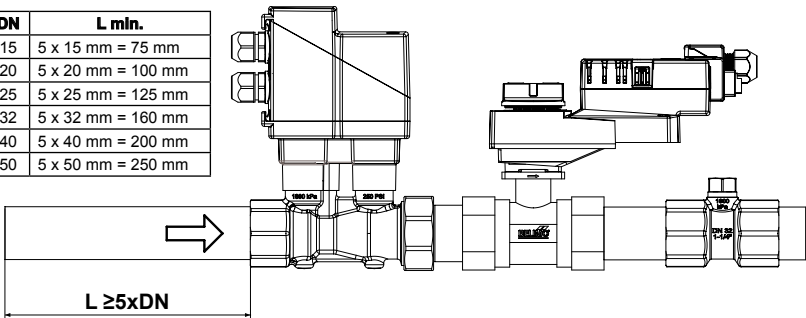

DN	L min.
65	5 x 65 mm = 325 mm
80	5 x 80 mm = 400 mm
100	5 x 100 mm = 500 mm
125	5 x 125 mm = 625 mm
150	5 x 150 mm = 750 mm

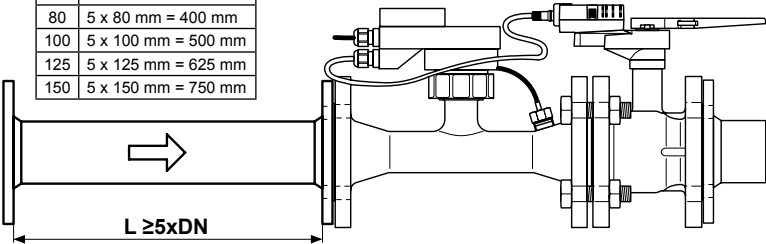

Installation of immersion sleeve and temperature sensor


- DN15-DN50

The valve is equipped with two fully-wired temperature sensors.

• T2: This sensor is installed on site near the valve unit.

• T1: This sensor is mounted at the installation site ahead of the consumer (valve in the return line) or after the consumer (valve in the supply line).

Two T-pieces for installation of the temperature sensors in the pipelines are included in the shipment.

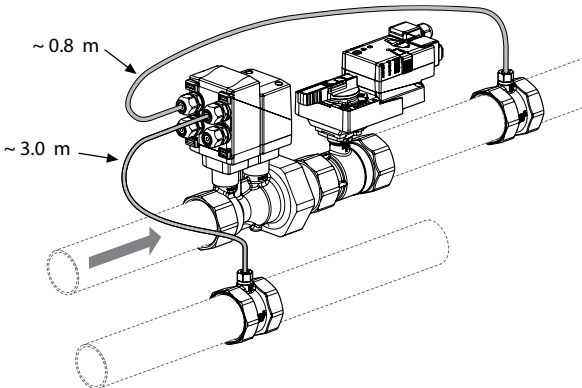

UL marked actuators is optional, please contact your local Sales Representative for details.


Installation notes

Installation of immersion sleeve and temperature sensor

DN65-DN150

The valve is equipped with two temperature sensors:

- T2: One sensor is already mounted in the valve unit.
- T1: The second sensor must be mounted at the installation site ahead of the consumer (valve in the return line; recommended) or after the consumer (valve in the supply line). The immersion sleeve required is supplied with the valve unit. The temperature sensor is already wired with the valve.

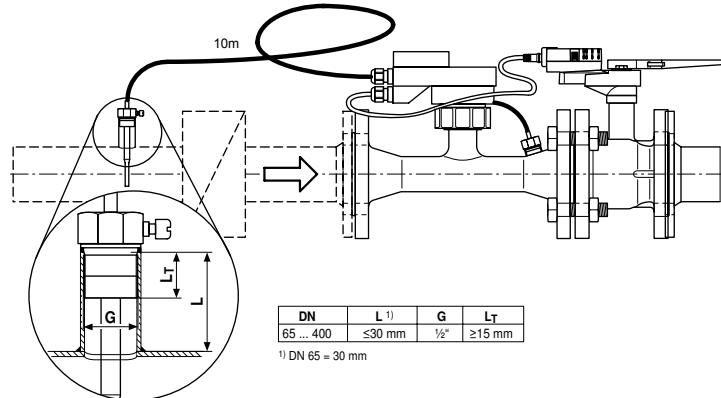

Note

The cables between valve unit and temperature sensors may not be either shortened or lengthened.

General information

Valve selection

The valve is determined using the maximum flow required \dot{V}_{\max} .

No calculation of the kvs value is required.

$\dot{V}_{\max} = 30 \dots 100\%$ of \dot{V}_{nom}

If no hydraulic data are available, then the same valve DN can be selected as the heat exchanger nominal diameter.

Minimum differential pressure (pressure drop)

The minimum required differential pressure (pressure drop through the valve) for achieving the desired volumetric flow \dot{V}_{\max} can be calculated with the aid of the theoretical kvs value (see type overview) and the below-mentioned formula. The calculated value is dependent on the required maximum volumetric flow \dot{V}_{\max} . Higher differential pressures are compensated for automatically by the valve.

Formula

$$\Delta p_{\min} = 100 \times \left(\frac{\dot{V}_{\max}}{k_{vs \text{ theor.}}} \right)^2$$

Δp_{\min} : kPa
\dot{V}_{\max} : m ³ /h
$k_{vs \text{ theor.}}$: m ³ /h

Example (DN25 with the desired maximum flow rate = 50% \dot{V}_{nom})

EV025R+BAC

$k_{vs \text{ theor.}} = 8.6 \text{ m}^3/\text{h}$

$\dot{V}_{\text{nom}} = 69 \text{ l/min}$

$50\% \times 69 \text{ l/min} = 34.5 \text{ l/min} = 2.07 \text{ m}^3/\text{h}$

$$\Delta p_{\min} = 100 \times \left(\frac{\dot{V}_{\max}}{k_{vs \text{ theor.}}} \right)^2 = 100 \times \left(\frac{2.07 \text{ m}^3/\text{h}}{8.6 \text{ m}^3/\text{h}} \right)^2 = 6 \text{ kPa}$$

Example (DN100 with the desired maximum flow rate = 50% \dot{V}_{nom})

P6100W2000EV-BAC

$k_{vs \text{ theor.}} = 100 \text{ m}^3/\text{h}$


$\dot{V}_{\text{nom}} = 1200 \text{ l/min}$

$50\% \times 1200 \text{ l/min} = 600 \text{ l/min} = 36 \text{ m}^3/\text{h}$

$$\Delta p_{\min} = 100 \times \left(\frac{\dot{V}_{\max}}{k_{vs \text{ theor.}}} \right)^2 = 100 \times \left(\frac{36 \text{ m}^3/\text{h}}{100 \text{ m}^3/\text{h}} \right)^2 = 13 \text{ kPa}$$

Dimensions [mm] / weight


Dimensional drawings

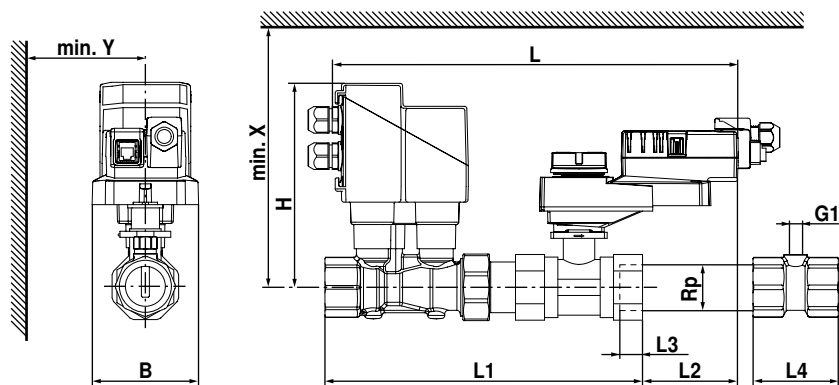

Type	DN [mm]	Rp ["]	L [mm]	L1 [mm]	L2 [mm]	L3 [mm]	B [mm]	H [mm]	G1	L4 [mm]	X [mm]	Y [mm]	Weight approx. [kg]
EV015R+BAC	15	1/2	278	191	81	13	75	160	G1/4"	53	230	77	2.2
EV020R+BAC	20	3/4	285	203	75	14	75	162	G1/4"	57	232	77	2.5
EV025R+BAC	25	1	296	231	71	16	75	165	G1/4"	65	235	77	2.9
EV032R+BAC	32	1 1/4	324	254	68	19	75	168	G1/4"	71	238	77	3.8
EV040R+BAC	40	1 1/2	334	274	65	19	75	172	G1/4"	71	242	77	4.5
EV050R+BAC	50	2	341	284	69	22	75	177	G1/4"	80	247	77	6.0
EV050R+BAC-N	50	2	341	284	69	22	75	177	G1/4"	80	247	77	6.0



Dimensions [mm] / weight

Dimensional drawings


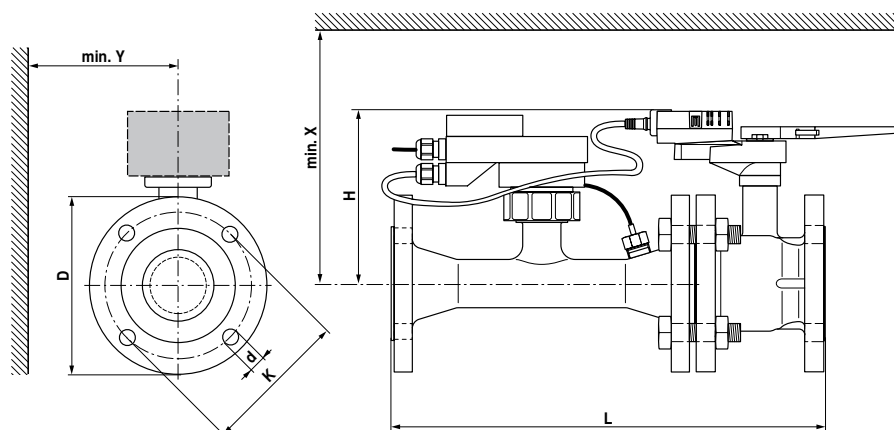


If Y < 180 mm, then the extension of the hand crank must be dismantled as necessary.

Type	DN [mm]	L [mm]	H [mm]	D [mm]	d [mm]	K [mm]	X [mm]	Y [mm]	Weight approx. [kg]
P6065W800EV-BAC	65	454	200	185	4 x 19	145	220	150	23.6
P6080W1100EV-BAC	80	499	200	200	8 x 19	160	220	160	28.7
P6100W2000EV-BAC	100	582	220	229	8 x 19	180	240	175	41.6
P6125W3100EV-BAC	125	640	240	252	8 x 19	210	260	190	54.7
P6150W4500EV-BAC	150	767	240	282	8 x 23	240	260	200	70.0
P6065W806EV-BAC	65	454	200	185	4 x 19	145	220	150	23.6
P6080W1106EV-BAC	80	499	200	200	8 x 19	160	220	160	28.7
P6100W2006EV-BAC	100	582	220	229	8 x 19	180	240	175	41.6
P6125W3106EV-BAC	125	640	240	252	8 x 19	210	260	190	54.7
P6150W4506EV-BAC	150	767	240	282	8 x 23	240	260	200	70.0

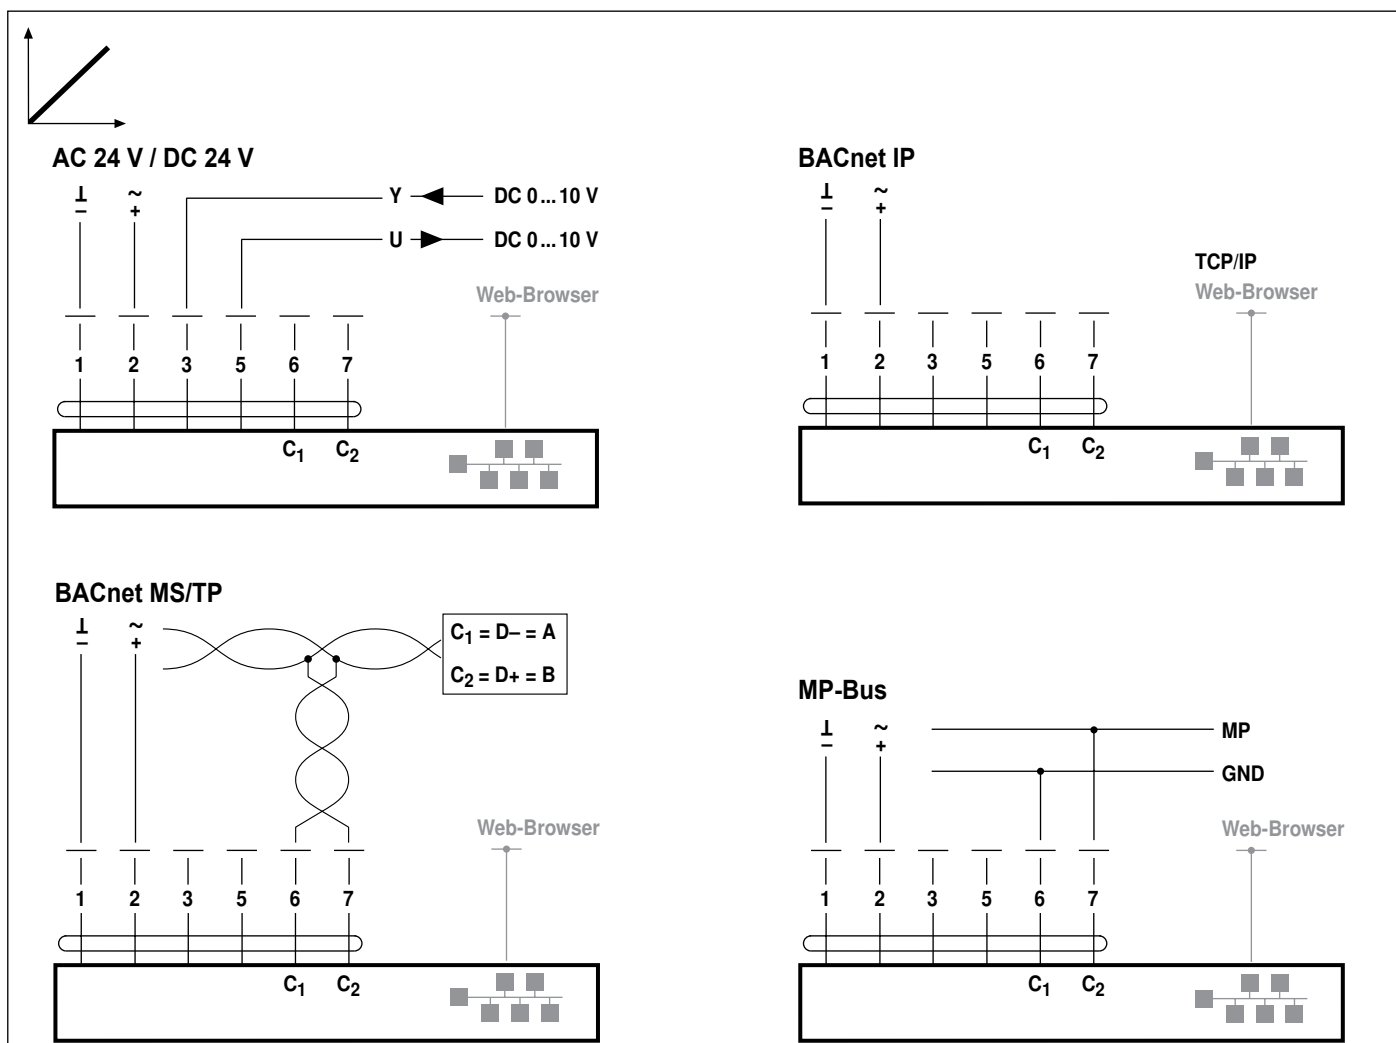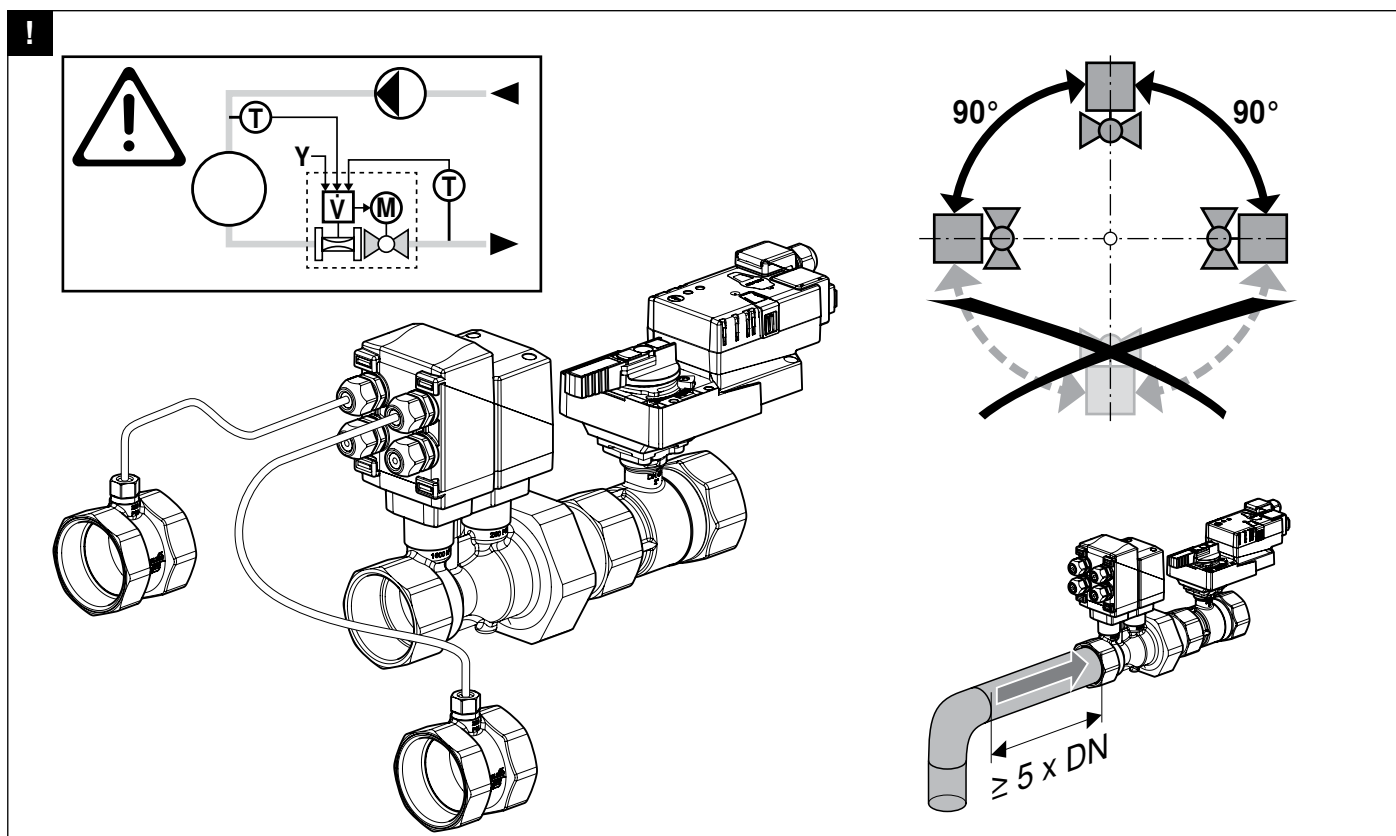

1

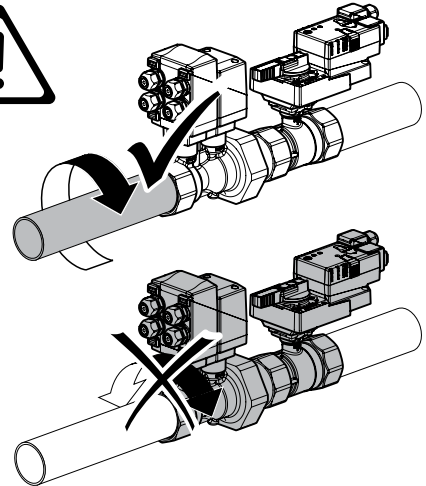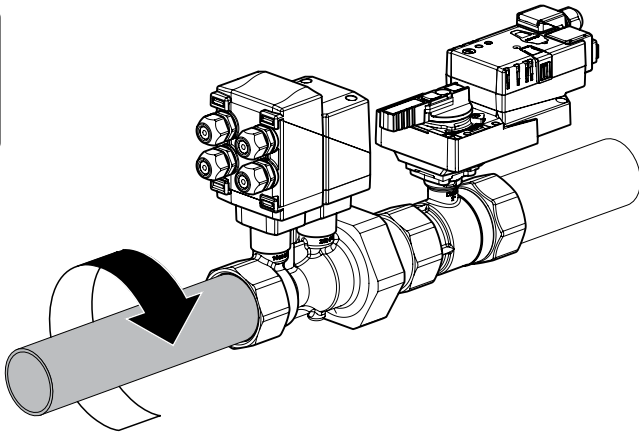


!











~ 0.8 m


~ 3.0 m

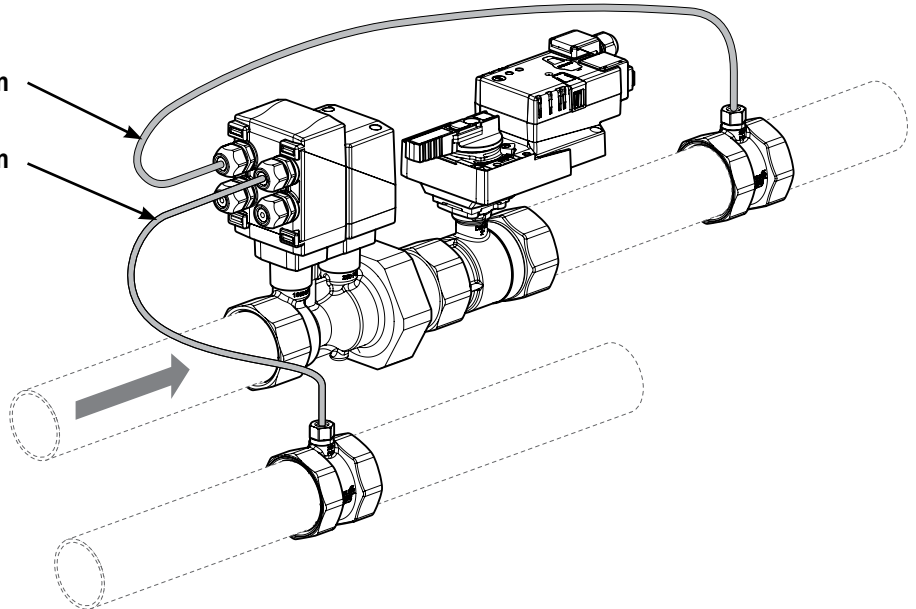

!



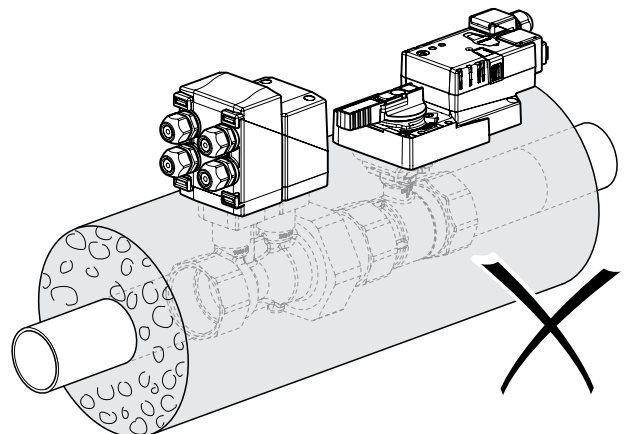
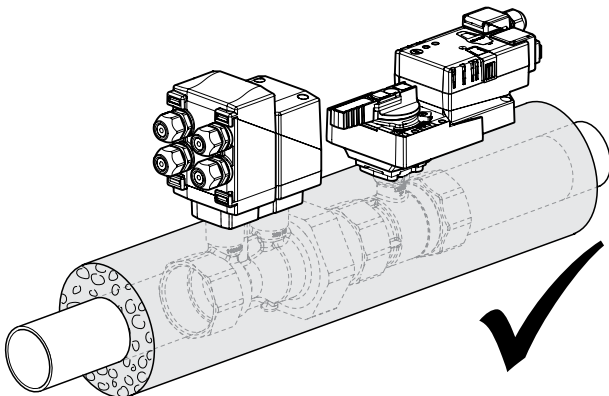


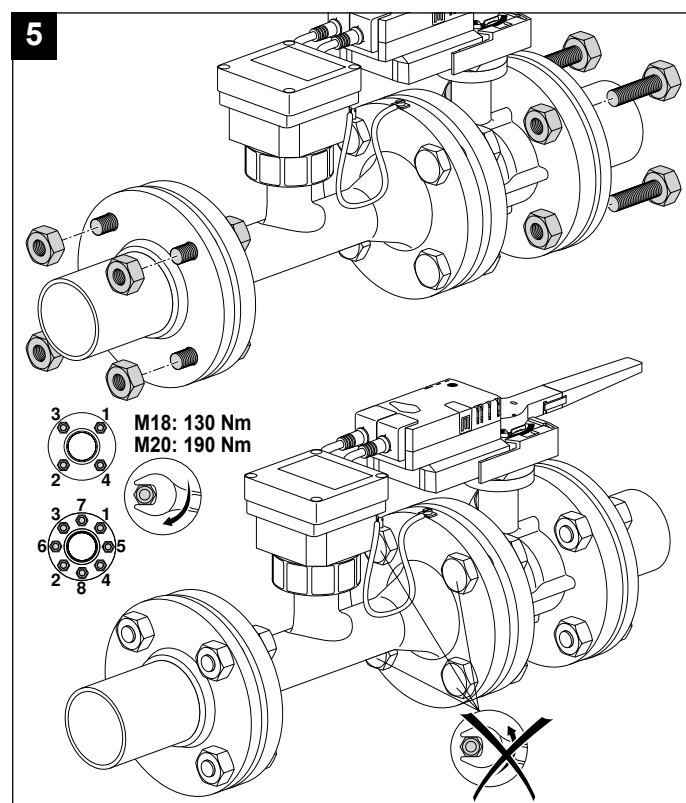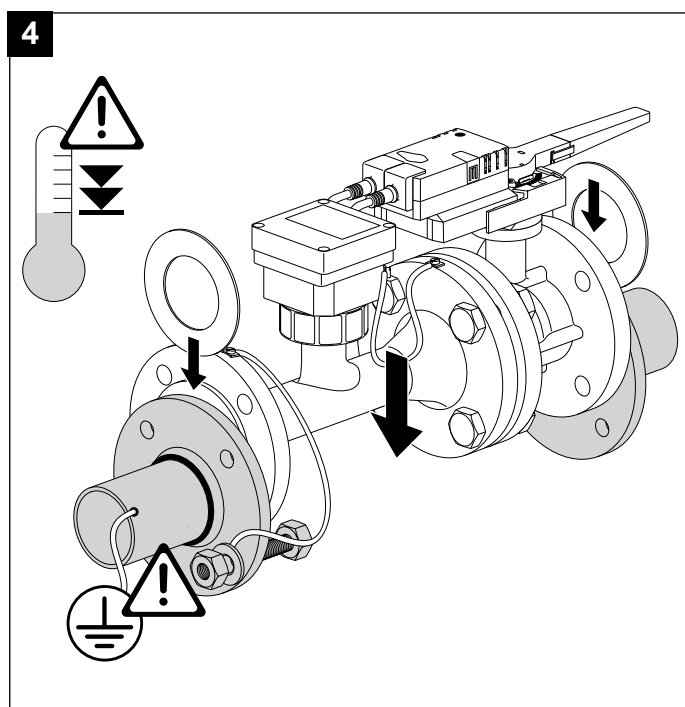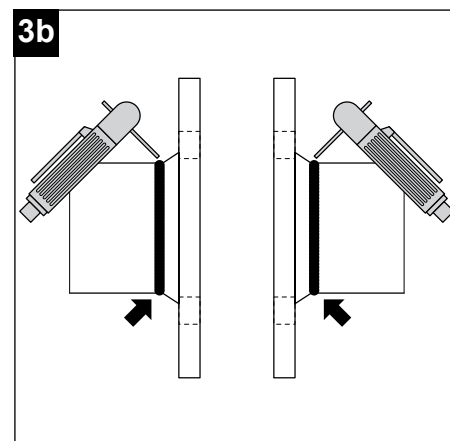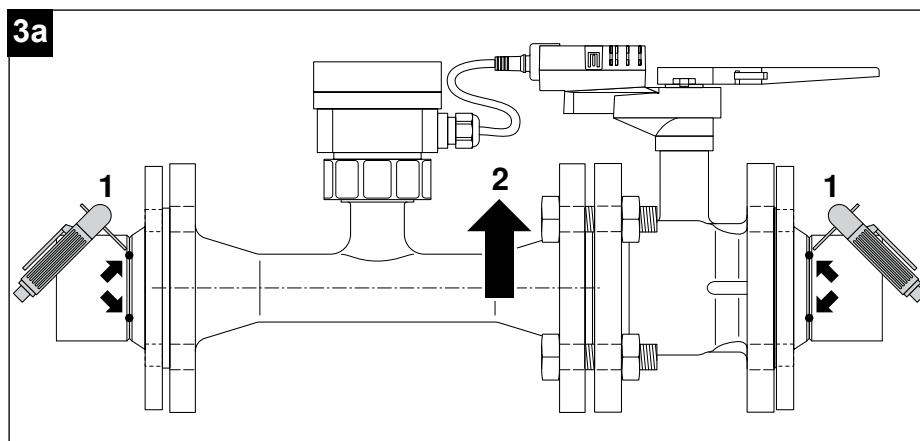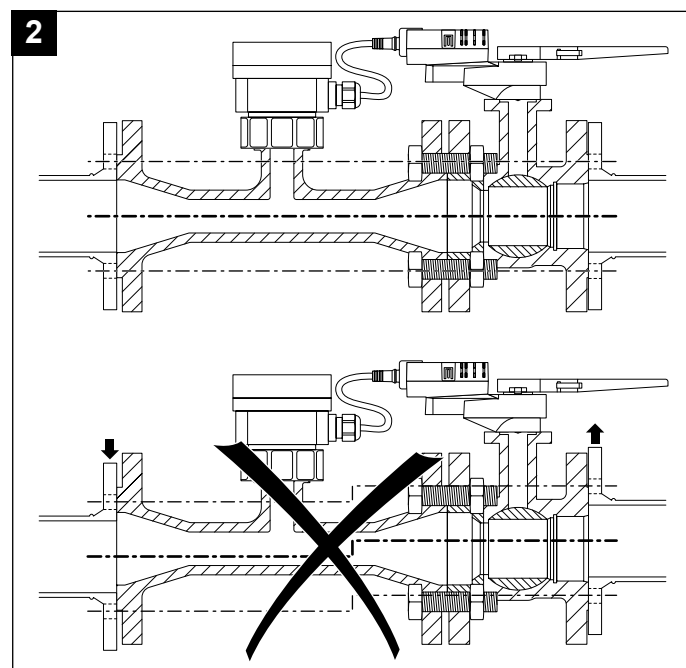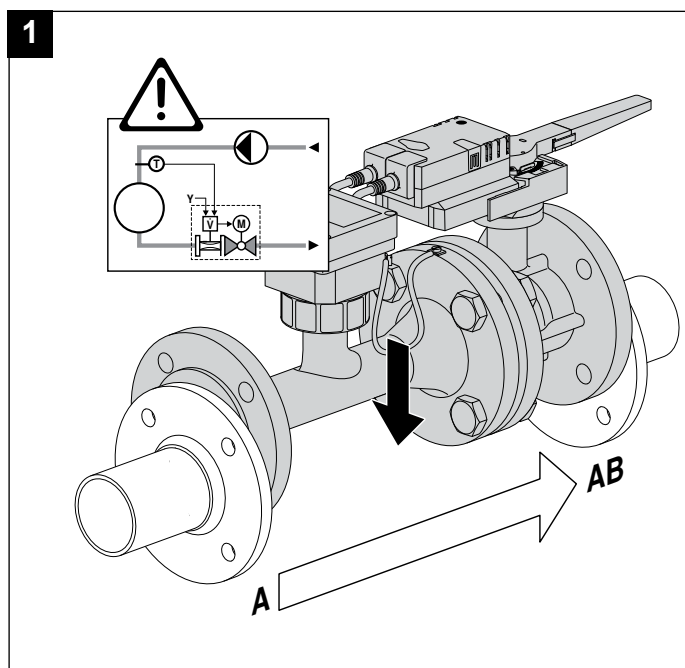


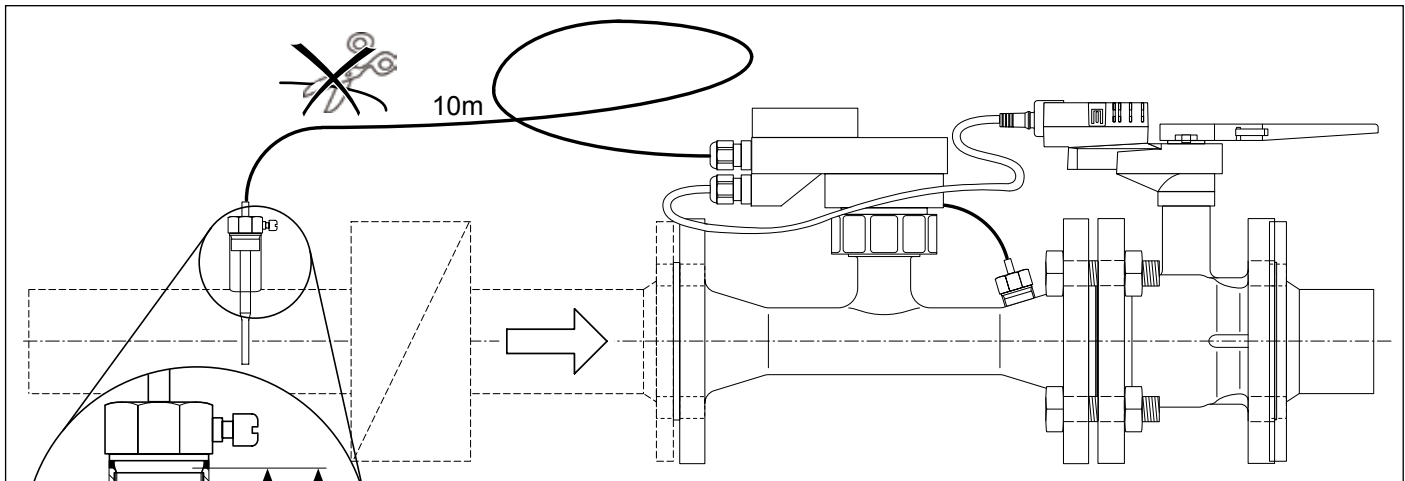


DN	L ¹⁾	G	LT
65 ... 400	≤30 mm	1/2"	≥15 mm

¹⁾ DN 65 = 30 mm

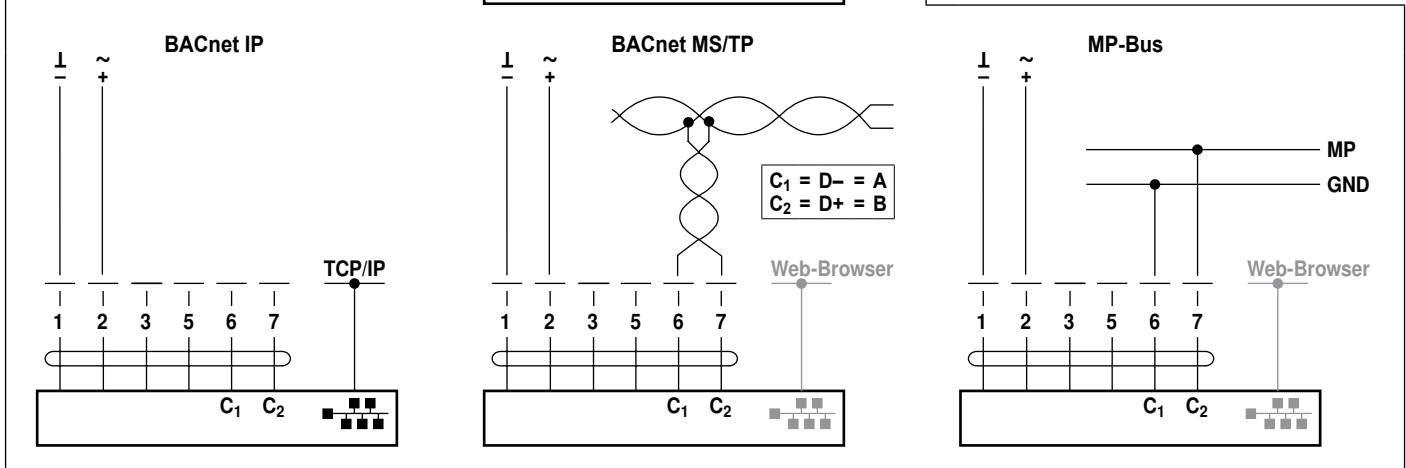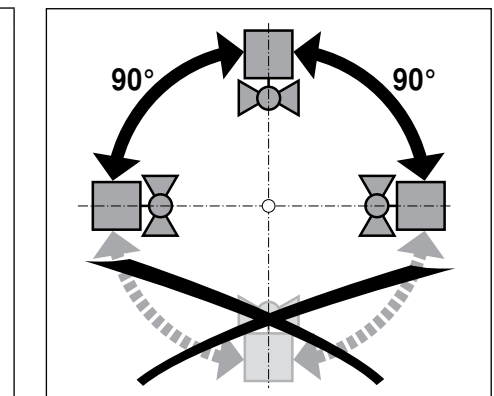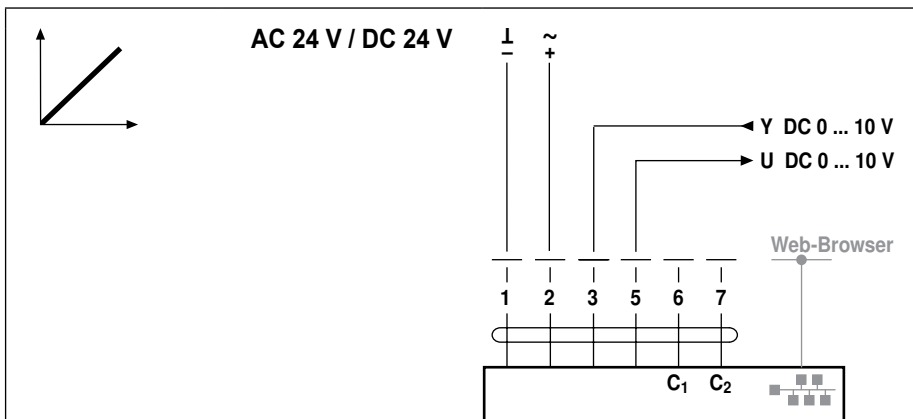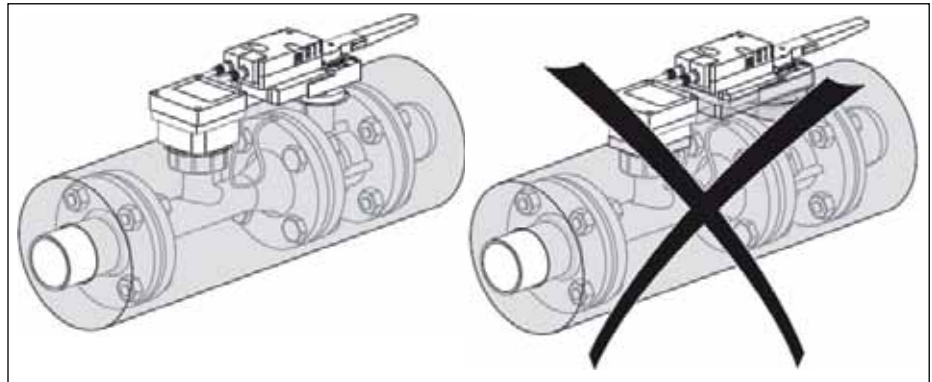

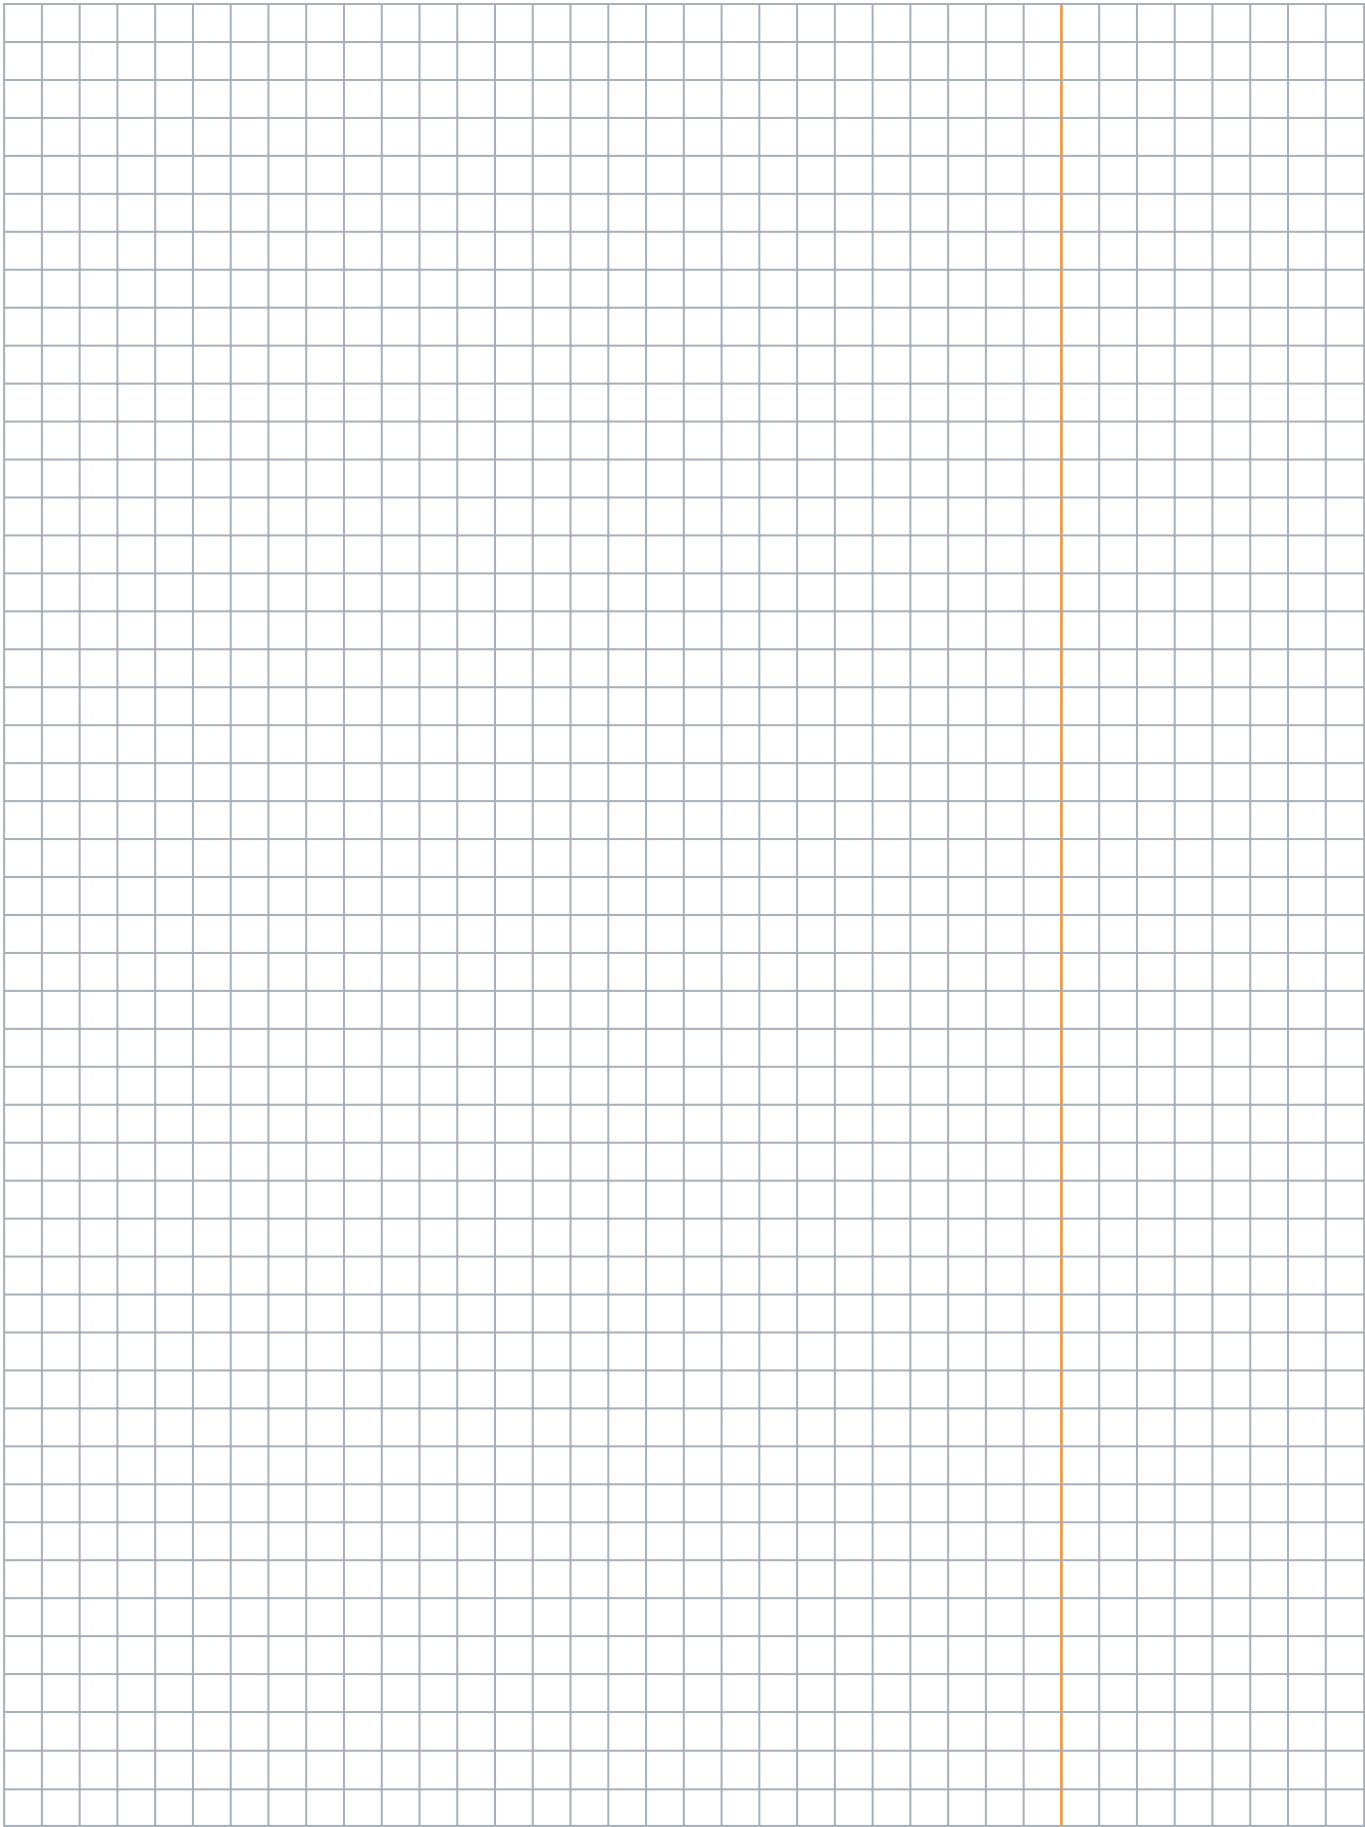

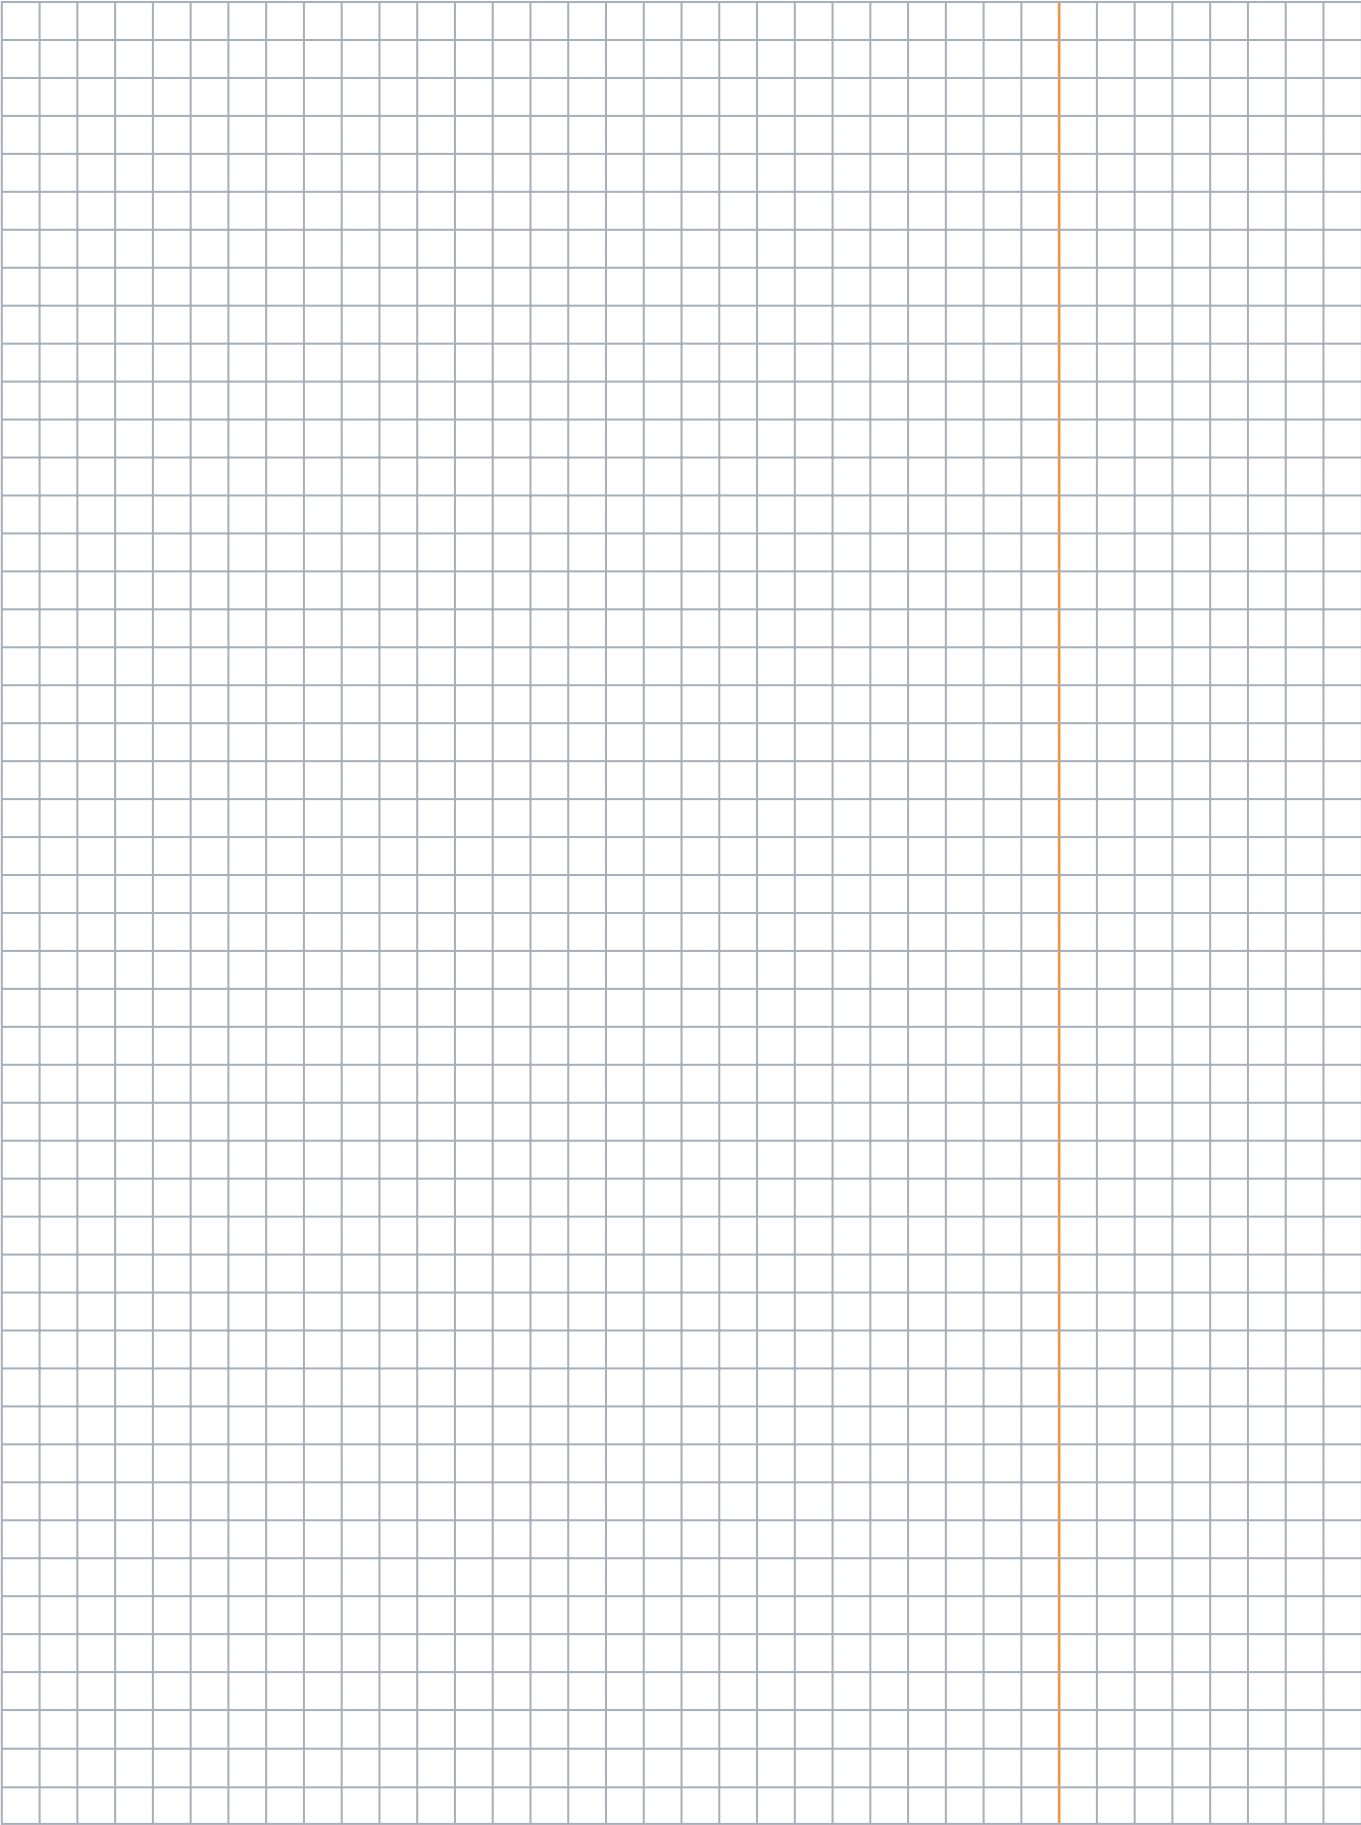

ASIA PACIFIC HEADQUARTERS**Belimo Actuators Ltd.**

Room 1601-6, 16/F, New Commerce Centre
19 On Sum Street, Shatin, N.T., Hong Kong
Tel: +852 2687 1716
Fax: +852 2687 1795
E-mail: info.asiapacific@belimo.ch

Belimo AUSTRALIA**Melbourne Office:**

Belimo Actuators Pty. Ltd.
12 Enterprise Court
Mulgrave Business Park
Mulgrave, VIC 3170, Australia
Tel: +61-(0)3-8585 7800
Fax: +61-(0)3-8585 7811
E-mail: info.australia@belimo.ch

Sydney Office:

Belimo Actuators Pty. Ltd.
Suite 2.20, 32 Delhi Road
North Ryde, NSW 2113, Australia
Tel: +61 (0)2 9805 1777
Fax: +61 (0)2 9805 1722
E-mail: info.australia@belimo.ch

Belimo CHINA**Shanghai Office:**

Belimo Actuators (Shanghai) Trading Ltd.
479 Chun Dong Road, Building C-2
Xin Zhuang Industry Park
Shanghai 201108, P.R. China
Tel: +86 21 5483 2929
Fax: +86 21 5483 2930
E-mail: info.shanghai@belimo.ch

Beijing Office:

Belimo Actuators Ltd.
Unit 1528-1530, 15F, Tower A,
Jiatai International Mansion,
No. 41, Middle East Fourth Ring Road,
Chaoyang District, Beijing, 100025, P.R. China
Tel: +86 10 6462 1382/1386
Fax: +86 10 6462 1383
E-mail: info.beijing@belimo.ch

Chongqing Office:

Belimo Actuators Ltd.
Room 4, 9th floor, Unit 7, Luoma Jiari Gardan
No. 36, Qing Ling Road, Nan'an District
Chongqing 400060, P.R. China
Tel: +86 23 6275 3155
Fax: +86 23 6280 33 80 *519
E-mail: info.chongqing@belimo.ch

Guangzhou Office:

Belimo Actuators Ltd.
Room 5217-5218, China International Centre,
Tower B, 33 Zhong Shan San Road, Yuexiu District,
Guangzhou 510055, P.R. China
Tel: +86 20 3435 1860
Fax: +86 20 3435 1870
E-mail: info.guangzhou@belimo.ch

Belimo HONG KONG**Hong Kong Office:**

Belimo Actuators Ltd.
Room 1601-6, 16/F, New Commerce Centre
19 On Sum Street, Shatin, N.T., Hong Kong
Tel: +852 2687 1716
Fax: +852 2687 1795
E-mail: info.hongkong@belimo.ch

Indonesia Office:

Belimo Actuators Ltd.
Graha Kencana Building 8th Floor Block B
Jl. Raya Perjuangan 88
Kebon Jeruk - Jakarta Barat 11530, Indonesia
Tel: +62 21 5367 8278
Fax: +62 21 5366 0688
E-mail: info.indonesia@belimo.ch

Japan Office:

Belimo Actuators Ltd.
2nd Floor, Yamaki Building III
3-1-5 Azumabashi, Sumida-ku
Tokyo 130-0001
Japan
Tel: +81 3 6823 6961
Fax: +81 3 3626 3911
E-mail: info.japan@belimo.ch

Malaysia Office:

Belimo Actuators Ltd
S-13-12, First Subang,
Jalan SS15/4G, 47500 Subang Jaya
Selangor, Malaysia
Tel: +03-56125833
Fax: +03-56125233
E-mail: info.malaysia@belimo.ch

Singapore Office

Belimo Actuators Ltd.
1 Tannery Road #08-04
One Tannery, Singapore 347719
Tel: +65 6842 1626
Fax: +65 6842 1630
E-mail: info.singapore@belimo.ch

Taiwan Office:

Belimo Actuators Ltd.
7F-2, No.343, Jhonghe Rd., Yonghe District,
New Taipei City 234, Taiwan
Tel: +886 2 2922 8805
Fax: +886 2 2922 8806
E-mail: info.taiwan@belimo.ch

Thailand Office:

Belimo Actuators Ltd.
90/2 Pensiri Place, Soi Phaholyothin 32
Phaholyothin Road, Chandrakasem, Jatujak
Bangkok 10900, Thailand
Tel: +662 9415582-3
Fax: +662 9415584
E-mail: info.thailand@belimo.ch

Belimo INDIA**Mumbai Office:**

Belimo Actuators India Pvt. Ltd.
23/ ABCD, Govt. Industrial Estate
Charkop, Kandivali West
Mumbai 400067, India
Tel: +91 22 4025 4800
Fax: +91 22 4025 4899
E-mail: info.india@belimo.ch

Bangalore office:

Belimo Actuators India Pvt. Ltd.
Sreerama Complex,
No. 13, 2nd Floor, 5th Cross Road
6th Block, Koramangala
Bangalore – 560097, India
Tel: +91-80-40906311
Fax: +91-80-40906288
E-mail: info.india@belimo.ch

New Delhi Office:

Belimo Actuators India Pvt. Ltd.
Flat No. 515, DLF Tower – B
Jasola Distt. Centre, Jasola
New Delhi 110025, India
Tel: +91 11 41078501
Fax: +91 11 41078508
E-mail: info.india@belimo.ch

Chennai Office:

Belimo Actuators India Pvt. Ltd.
Flat no.3B, Urmilla House
#15, ARK Colony, Eldams Road
Chennai-600 018, India
Tel: +91 44 24355154/5153
E-mail: info.india@belimo.ch

FIRE &
SMOKE



DAMPER



PICCV
EPIV
EV



CCV



BUTTERFLY
VALVE



GLOBE
VALVE



Innovation, Quality and Consultancy:

A partnership for motorising HVAC actuators



5 year warranty



On site around the globe



A complete range of
products from one source



Tested quality



Short delivery
times



Comprehensive
support

Belimo regional head offices

EU BELIMO Automation AG
Brunnenbachstrasse 1
8340 Hinwil, Switzerland
Tel: +41 43 843 61 11
Fax: +41 43 843 62 68
E-mail: info@belimo.ch

AP Belimo Actuators Ltd.
Room 1601-6, 16/F, New Commerce Centre
19 On Sum Street, Shatin, N.T., Hong Kong
Tel: +852 2687 1716
Fax: +852 2687 1795
E-mail: info.asiapacific@belimo.ch

US BELIMO Aircontrol (USA), Inc.
33 Turner Road
Danbury, CT 06810
USA
Tel: +800 543-9038 / 203 791-9915
Fax: +800 228-8283 / 203 791-9919

Or contact your nearest Sales Representative

www.belimo.com

BELIMO®

93010-00169